46866002.01_54.cdr

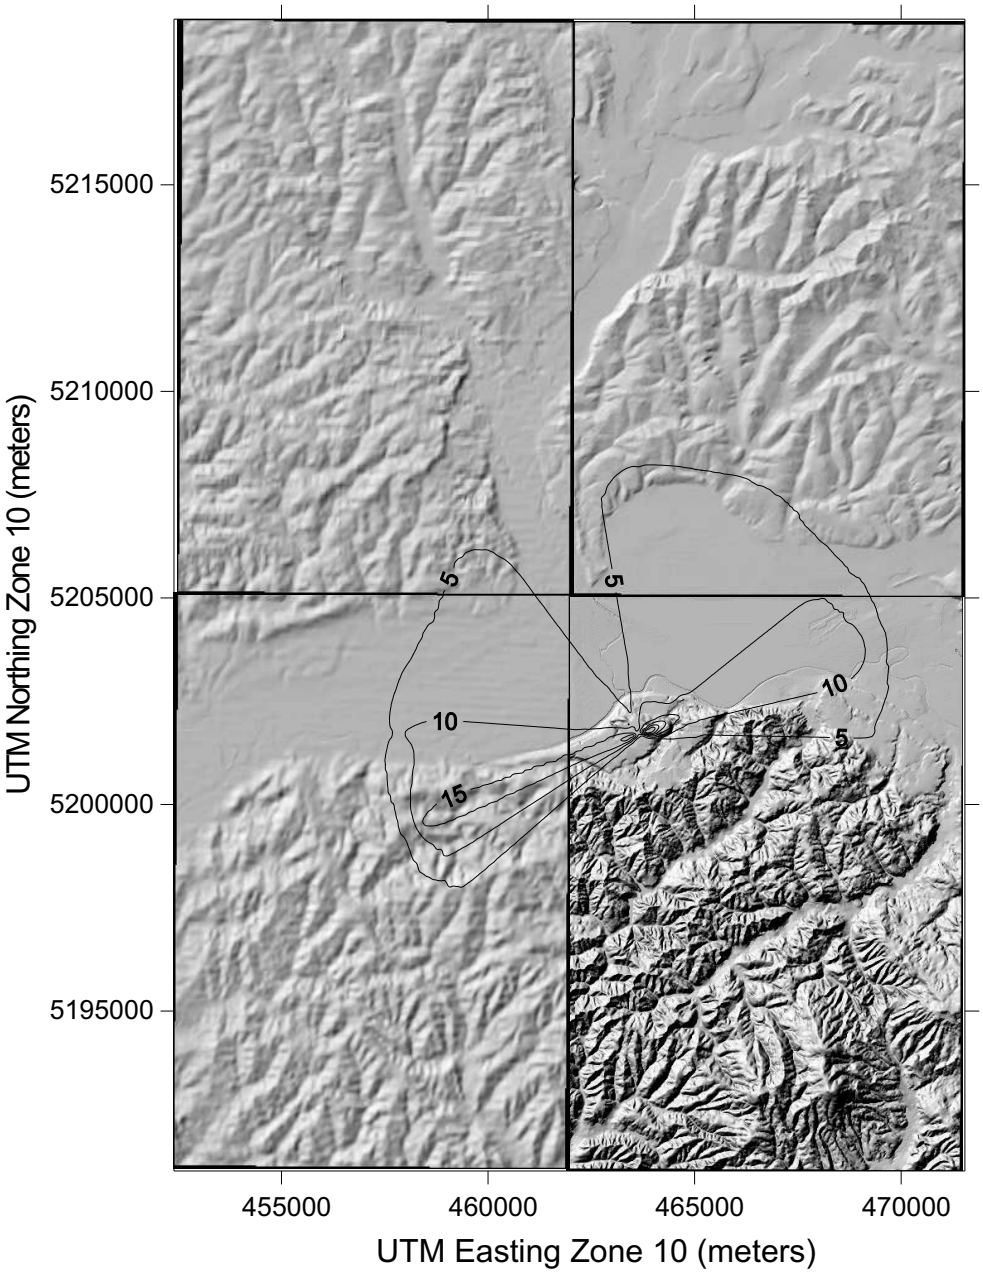

Figure 3.2-2

Combined Annual Frequency of Occurrence of Visible Plume – Impacts from Both Cooling Towers