

Note: not to scale

Existing Lower Monumental-McNary 500-kV Line
Voltage: 540 kV (average), 550 kV (maximum)
Peak Current: 1868/1532 A (existing/proposed)
Conductors: 3 x 1.302 in., 17.04 in. spacing

Proposed BPA 500-kV Line
Voltage: 540 kV (average), 550 kV (maximum)
Peak Current: 1445 A (proposed)
Conductors: 3 x 1.300 in., 17.04 in. spacing

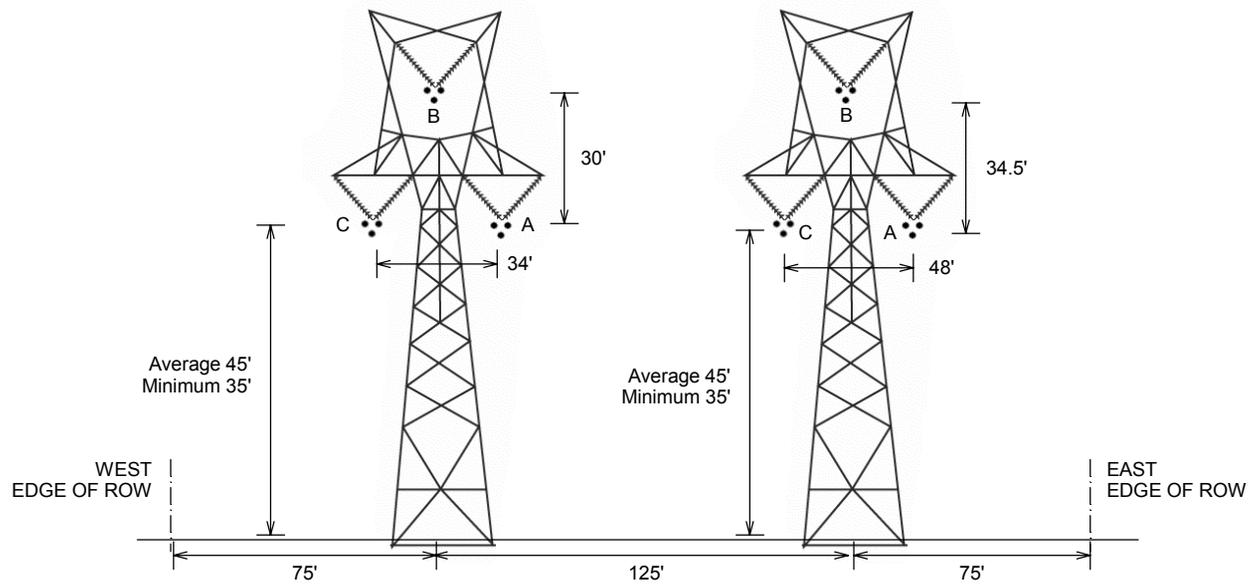


Figure 2-5, continued
Configurations for the Proposed Wallula-McNary 500-kV Line
Proposed line with parallel Lower Monumental - McNary No. 1 500-kV line (Configuration 4a)
(4 of 5)
Wallula Power Project